



Test Report : SHP-10K-115

10KW 3 ψ 3W High Efficiency Digital Power Supply

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Control Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test



E.M.C. Test

■ RELIABILITY TEST


ENVIRONMENT TEST

DESIGN VERIFY TEST

OUTPUT FUNCTION TEST

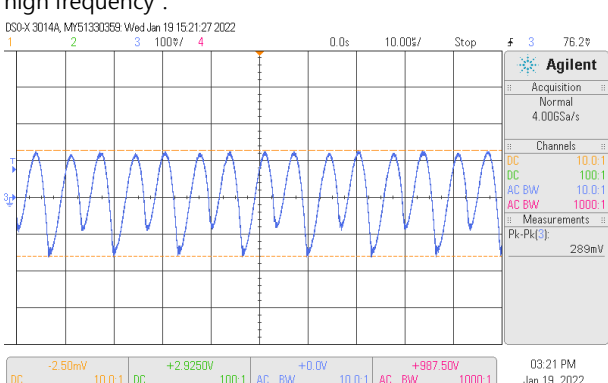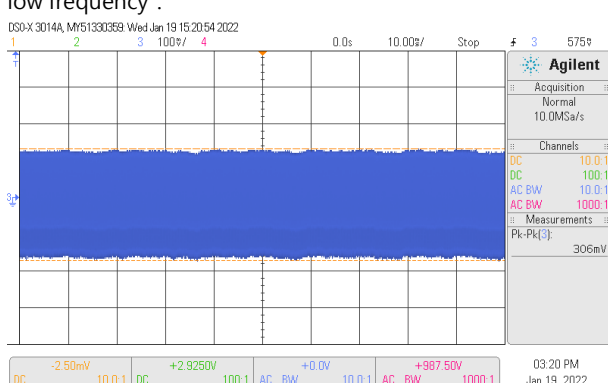
NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	CH1 : 90V~ 138 V	I/P : 400VAC I/P : 340 VAC O/P : MIN LOAD Ta : 25°C	87.27V~142.44V/400VAC 87.27V~142.46V /340VAC
2	OUTPUT VOLTAGE(Max) TOLERANCE	V1 : 1%~ -1 %	I/P : 340VAC /530VAC O/P : FULL/ MIN. LOAD Ta : 25°C	V1 : 0.26 %~ -0.017 %
3	LINE REGULATION (Max)	V1 : 0.5%~ -0.5 %	I/P : 340VAC~ 530VAC O/P : FULL LOAD Ta : 25°C	V1 : -0.087 %~ -0.034 %
4	LOAD REGULATION(Max)	V1 : 0.5%~ -0.5 %	I/P : 400VAC O/P : FULL ~MIN LOAD Ta : 25°C	V1 : 0.095 % ~ -0.078 %
5	OVER/UNDERSHOOT TEST	< $\pm$ 10%	I/P : 400VAC O/P : FULL LOAD Ta : 25°C	< $\pm$ 10%
6	RIPPLE & NOISE(Max)	V1 : 0.6Vp-p	I/P : 400VAC O/P : FULL LOAD Ta : 25°C	0.36V
high frequency :  low frequency : 				
7	SET UP TIME(Max)	400VAC/3000ms	I/P : 400VAC O/P : FULL LOAD Ta : 25°C	2020ms
INPUT=400VAC/50HZ @ FULL LOAD CH3 : Output Voltage CH4 : AC Input Voltage				

8	RISE TIME (Max)	400VAC/100ms	I/P : 400VAC O/P : FULL LOAD Ta : 25°C	64ms
INPUT=400VAC/50HZ @ FULL LOAD CH1 : Output Voltage				
9	HOLD UP TIME (Typ.)	20ms / 400VAC at full load 25ms / 400VAC at 75% load	I/P : 400VAC O/P : FULL LOAD 75% load Ta : 25°C	20.4 ms at full load 28.0 ms at 75% load
INPUT=400VAC/50HZ @ FULL LOAD CH3 : Output Voltage CH4 : AC Input Voltage INPUT=400VAC/50HZ @ 75% LOAD CH3 : Output Voltage CH4 : AC Input Voltage				
10	DYNAMIC LOAD	V1 : 11.5Vp-p	I/P : 400VAC O/P : (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY /	1080mVp-p 850mVp-p

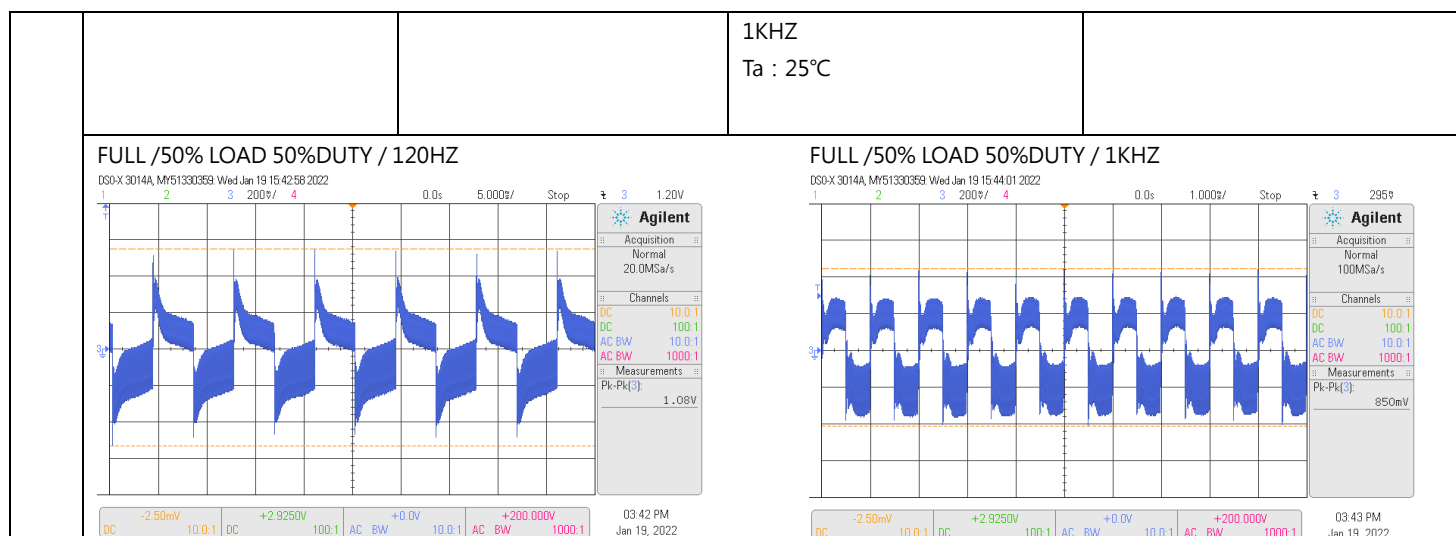


INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	340VAC~530VAC	(1) I/P : TESTING O/P : FULL LOAD Ta : 25°C	(1) 335V~530V
			I/P : LOW-LINE-3V=337V HIGH-LINE+10V=540 V O/P : FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON : 30 Sec OFF : 30 Sec 10MIN (POWER ON/OFF NO DAMAGE)	TEST : OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P : 340 VAC ~530 VAC O/P : FULL~MIN LOAD Ta : 25°C	TEST : PASS
3	INPUT CURRENT (Typ.)	400V / 15.7 A 480V/ 13 A	I/P : 400VAC I/P : 480 VAC O/P : FULL LOAD Ta : 25°C	I =15.23A/ 400VAC I =12.85A/ 480VAC
4	LEAKAGE CURRENT	< 6.5mA / 530 VAC	I/P : 530 VAC O/P : Min LOAD Ta : 25°C	L1-FG : 5.2mA peak L2-FG : 5.2mA peak L3-FG : 5.1mA peak
5	POWER FACTOR (Typ.)	≥ 0.98 / 400VAC ≥ 0.98 /480VAC	I/P : 400VAC I/P : 480 VAC O/P : FULL LOAD Ta : 25°C	PF= 0.999 PF= 0.998
	P.F vs LOAD			

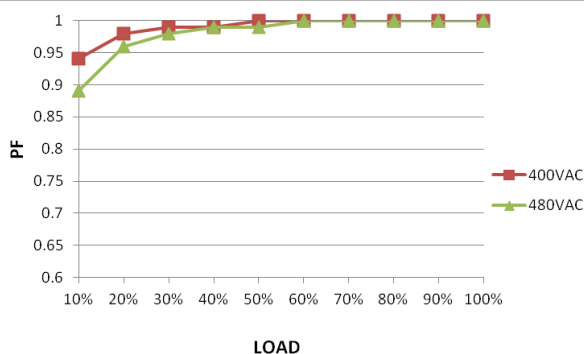

6	EFFICIENCY(Typ.)	96%	I/P : 480VAC O/P : FULL LOAD Ta : 25°C	96.02%
---	------------------	-----	--	--------


EFFICIENCY vs LOAD

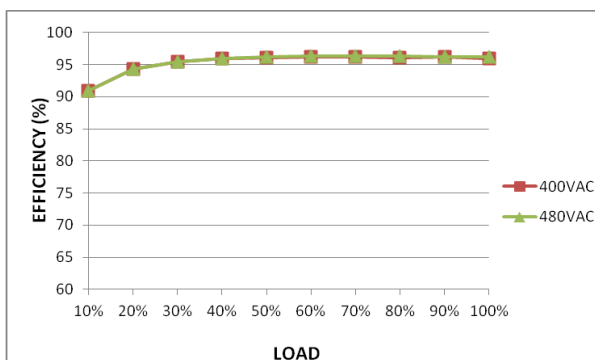

7	INRUSH CURRENT(Typ.)	40A@400VAC 65A@480VAC COLD START	I/P : 400VAC I/P : 480 VAC O/P : FULL LOAD Ta : 25°C	I = 33.2A/ 400VAC T50=2.38ms I = 43.6A/ 480VAC T50=2.58ms
---	----------------------	--	---	--


INPUT=400VAC/50HZ @ FULL LOAD

CH4 : AC Input Voltage CH3 : Input current

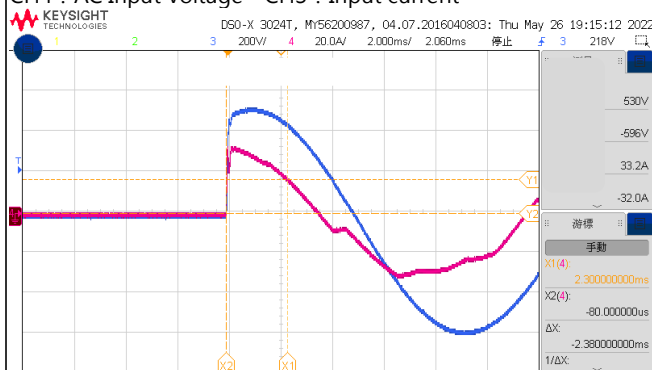

INPUT=480VAC/ 60HZ @ FULL LOAD

CH3 : AC Input Voltage CH4 : Input current

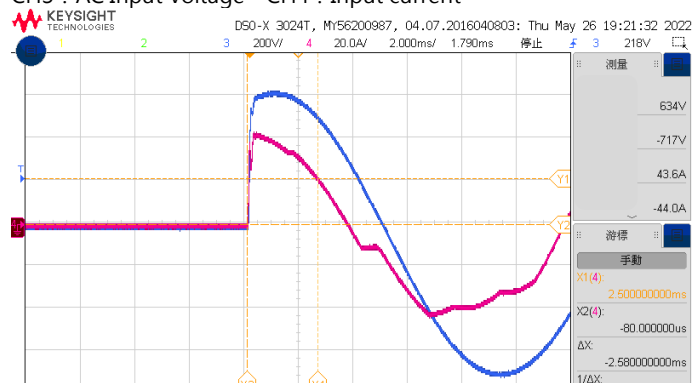

PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	100%~ 105 % PROTECTION TYPE : Constant current limiting, unit will shutdown after 5 sec. re-power on to recover	I/P : 530 VAC I/P : 400VAC I/P : 340VAC O/P : TESTING Ta : 25°C	104.14% 104.14% 103.62% PROTECTION TYPE : Constant current limiting, unit will shutdown after 5 sec. re-power on to recover
2	OVER VOLTAGE PROTECTION	145V~166V PROTECTION TYPE : Shut down o/p voltage, re-power on to recover	I/P : 530 VAC I/P : 400VAC I/P : 340 VAC O/P : MIN LOAD Ta : 25°C	154.86V/ 530 VAC 154.9V/ 400VAC 154.41V/ 340VAC PROTECTION TYPE : Shut down o/p voltage, re-power on to recover
3	OVER TEMPERATURE PROTECTION	Protection type : Shut down o/p voltage, recovers automatically after temperature goes down	I/P : 530 VAC I/P : 340 VAC O/P : FULL LOAD	O.T.P. Active Protection type : Shut down o/p voltage, recovers automatically after temperature goes down
4	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P : 530 VAC I/P : 340 VAC O/P : FULL LOAD Ta : 25°C	NO DAMAGE PROTECTION TYPE : Constant current limiting, unit will shutdown after 5 sec. re-power on to recover

CONTROL FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT								
1	AUXILIARY POWER (AUX)	Auxiliary voltage output, 11.4~12.6V, referenced to GND-AUX (pin15 & 16). The maximum load current is 1A. This output is not controlled by "Remote ON-OFF" . I/P : 400VAC O/P : FULL LOAD Ta : 25°C Test Result : PASS <table><tr><td>AUX</td><td>TOLERANCE</td><td>RIPPLE</td><td>TEST RESULT</td></tr><tr><td>12V / 1A</td><td>11.4~12.6V</td><td>150mVp-p</td><td>No Load : 12.058V Full Load : 11.689V Ripple : 18mV</td></tr></table>			AUX	TOLERANCE	RIPPLE	TEST RESULT	12V / 1A	11.4~12.6V	150mVp-p	No Load : 12.058V Full Load : 11.689V Ripple : 18mV
AUX	TOLERANCE	RIPPLE	TEST RESULT									
12V / 1A	11.4~12.6V	150mVp-p	No Load : 12.058V Full Load : 11.689V Ripple : 18mV									

2 REMOTE ON/OFF CONTROL

4.Remote ON-OFF Control

※ The power supply can be turned ON-OFF by using the "Remote ON-OFF" function.

Between Remote ON-OFF(CN86 pin1) and 5V-AUX(CN86 pin2)	Output Status
Switch close (Short)	power supply ON
Switch open (Open)	power supply OFF

Table 4.1

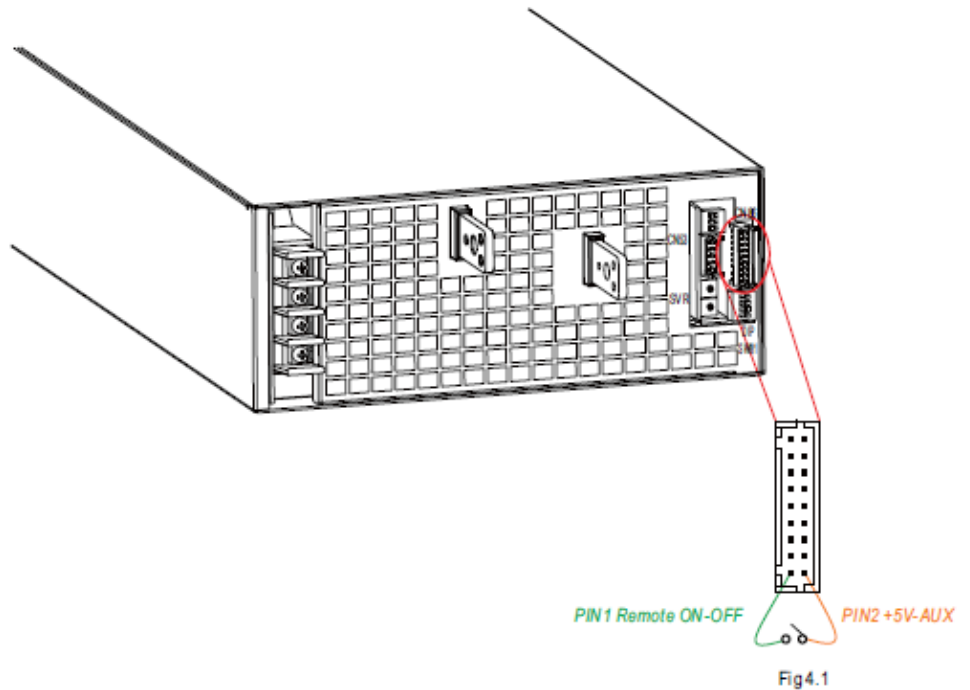


Fig4.1

I/P : 400VAC

O/P : FULL LOAD

Ta : 25°C


Test Result : PASS

Between Remote ON-OFF(CN86 pin1) and 5V-AUX(CN86 pin2)	Output Status
Switch close (Short)	power supply ON
Switch open (Open)	power supply OFF

3 ALARM SIGNAL

5. Alarm Signal Output

※ There are 4 alarm signals, DC-OK, T-ALARM, Fan Fail and AC-OK, in TTL signal form, on CN86. These signals are isolated from output.

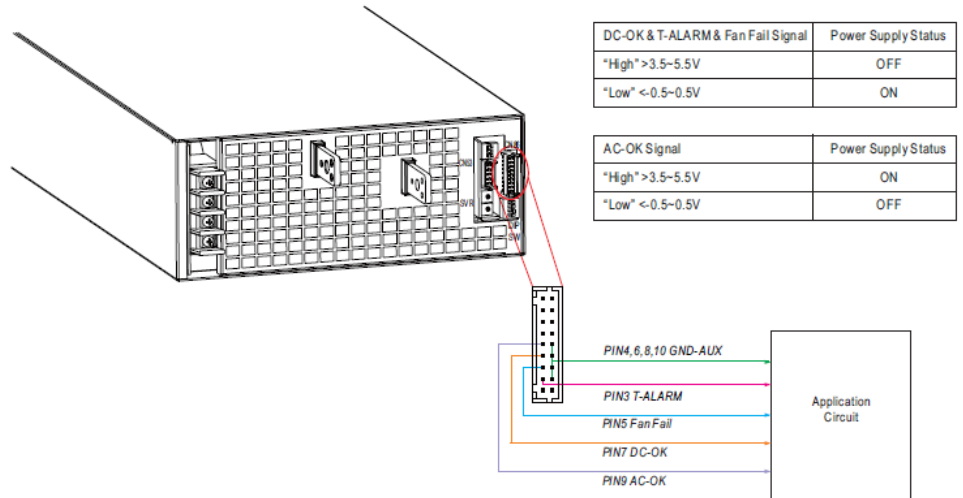

※ DC OK might mis-triggered when the voltage difference between PSU and the load, please minimized the unnecessary voltage difference.

1. DC OK SIGNAL

High (3.5 ~ 5.5V) : When the $V_{out} \leq 80\% \pm 6\%$.

Low (-0.5 ~ 0.5V) : When the $V_{out} \geq 80\% \pm 6\%$.

The maximum sourcing current is 10mA and only for output.

I/P : 400VAC

O/P : FULL LOAD

Ta : 25°C

Test Result :

Vout	DC OK SIGNAL
$V_{out} \leq 74\%$	5.05V
$V_{out} \geq 86\%$	0V

2. T-ALARM

High (3.5 ~ 5.5V) : When the internal temperature exceeds the limit of temperature alarm.

Low (-0.5 ~ 0.5V) : When the internal temperature is normal.

The maximum sourcing current is 10mA and only for output.(Note)

I/P : 400VAC

O/P : FULL LOAD

Ta : 25°C

Test Result :

PSU STATUS	T-ALARM SPEC	T-ALARM TEST
NORMAL	-0.5 ~ 0.5V	0V
OTP	3.5~5.5V	5.02V

3. AC OK
 High (3.5 ~ 5.5V): When AC input $\geq 335 \pm 1.5\%$ Vac, PSU works normally.
 Low (-0.5 ~ 0.5V): When AC input $\leq 320 \pm 1.5\%$ Vac, PSU shut down.
 The maximum sourcing current is 10mA and only for output.(Note)
 I/P : 400VAC
 O/P : FULL LOAD
 Ta : 25°C
 Test Result :

AC	AC OK SIGNAL
$AC \leq 320V$	0V
$AC \geq 335V$	5.06V

4. FAN FAIL
 High(3.5~5.5V):When the fan fail.
 Low(-0.5~0.5V):When the fan works normally.
 The maximum sourcing current is 10mA and only for output.(Note)
 I/P : 400VAC
 O/P : FULL LOAD
 Ta : 25°C
 Test Result :

FAN	AC OK SIGNAL
Fan works	0V
Fan lock	5.05V

4 OUTPUT VOLTAGE PROGRAMMABLE(PV)

1.Output Voltage Programming (or, PV / remote voltage programming / remote adjust / margin programming / dynamic voltage trim)

(1)by potentiometer (SVR)

(a)Have the DIP switch position-3 set as





(b)Output voltage can be trimmed by SVR.

(2)by Output Voltage Programming


(a)Have the DIP switch position-3 set as



(b)The output voltage can be trimmed to 50~120% by applying EXTERNAL VOLTAGE between PV+ and PV- on CN53.

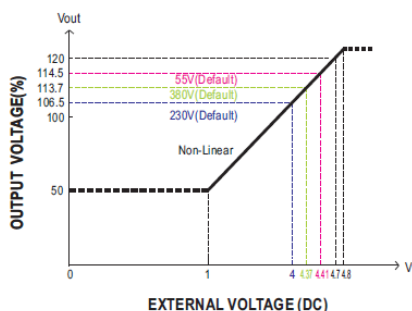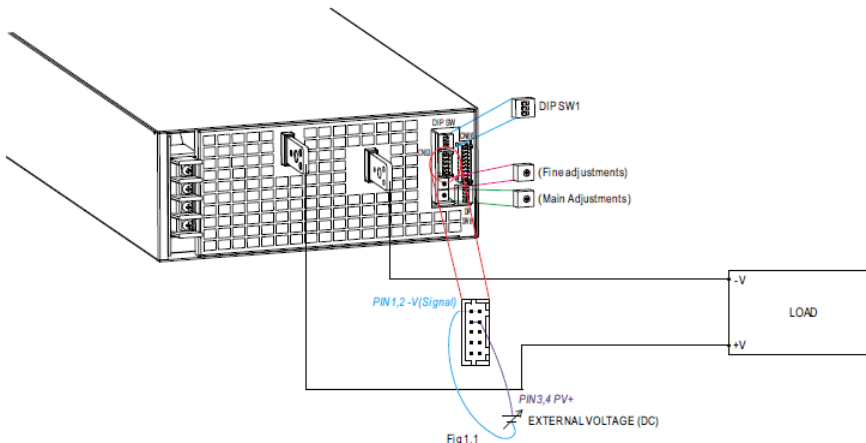

© The 100% output voltage is 48/115/216/334V.

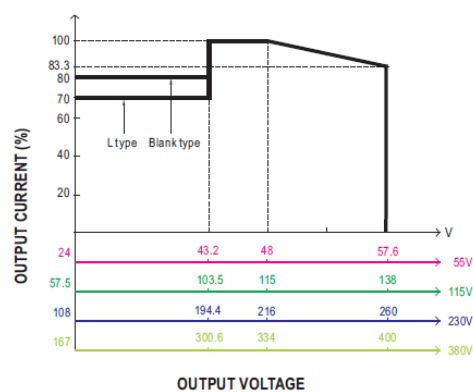

© The rated current should change with the Output Voltage Programming accordingly.

I/P: 400VAC

O/P:FULL LOAD

Ta:25°C


TEST RESULT :

MODEL \ PV	1V	5V
SPEC	57.5V±5%	138V±5%
Vout	58.43V	140.4V



5 OUTPUT CURRENT PROGRAMMABLE (PC)

2. Constant Current Programming (or, PC / remote current programming / dynamic current trim)

- (1) Default Overload Protection(OLP) value
 - (a) Have the DIP switch position-2 set as
 - (b) Output current is set default value.
- (2) by Constant Current Level Programming
 - (a) Have the DIP switch position-2 set as
 - (b) The constant current level can be trimmed to 20~100% of the rated current by applying EXTERNAL VOLTAGE between PC+ and PC- on CN53.

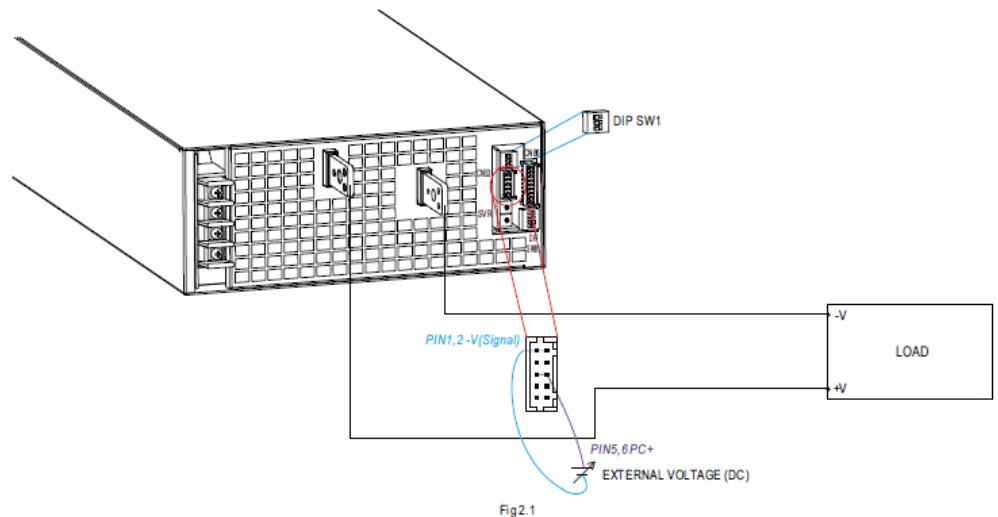

※ Under PC function at wattage < 4KW, the power supply might enter burst mode and cause output unstable, please increase the load to minimized the effect.
 ※ Auto de-rating function covered by over temperature protection, it works either in PC mode or under control by communication protocol.
 T₁(Typ.): Maximum ambient temperature of full load.
 T₂(Typ.): T₁+5°C.

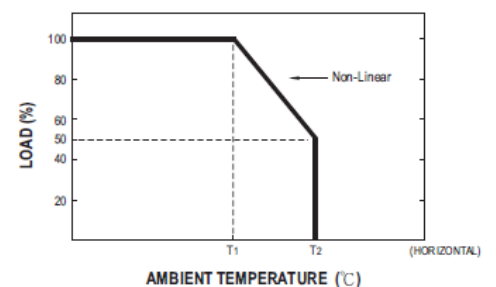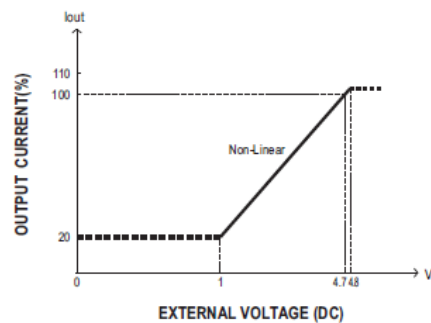

I/P : 400VAC
 O/P : TESTING (factory default)
 Ta : 25°C

	PC	
MODEL	1V	5V
SPEC	17.4A±10%	88.88A±10%
I _{out}	16.8A	88.69A

6	CURRENT SHARING	CURRENT SHARING TOLERANCE $<\pm 10\%$	I/P : 400 VAC O/P : 115V (factory default) 100/50% LOAD Ta : 25°C	O/P : 100% PSU1 : 87.4 A PSU2 : 86.2 A PSU3 : 85.2 A PSU4 : 84.8 A O/P : 50% PSU1 : 43 A PSU2 : 43.2 A PSU3 : 43.6 A PSU4 : 43.2 A
---	-----------------	--	--	---

COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Transistor (D to S) or (C to E) Peak Voltage	Q401 Rated : 95A/1200V VGS : -10V~+22V	AC ON/OFF I/P : High-Line +3V =533V <u>VO : 115V</u> O/P : (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→120% Load. Ta : 25°C	Q401 <u>VO : 115V</u> VDS : (1) 946V (2) 954V (3) 930V (4) 938V (5) 930V (6) 938V (7) 946V
2	P.F.C Transistor (D to S) or (C to E) Peak Voltage	Q163 Rated : 119A/650V VGS : -10~+22V	I/P : High-Line +3V =533V AC ON/OFF <u>VO : 115V</u> O/P : (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→120% Load.	<u>VO : 115V</u> VDS : (1) 493V (2) 493V (3) 489V (4) 521V (5) 485V (6) 461V (7) 533V

			Ta : 25°C		
3	P.F.C DIODE	D163 Rated : 15A/1200V	I/P : High-Line +3V =533V AC ON/OFF <u>VO : 115V</u> O/P : (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (4)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz Ta : 25°C	<u>VO : 115V</u> VD : (1) 897V (2) 897V (3) 889V (4) 857V	
4	Diode Peak Voltage	D610 Rated : 20A / 650V D613 Rated : 20A / 650V D616 Rated : 20A / 650V D619 Rated : 20A / 650V	AC ON/OFF I/P : High-Line +3V =533V <u>VO : 115V</u> O/P : (1)Full Load (2)Output Short (3)Dynamic Load Full Load/ Min. Load 90%Duty/1KHz (4)Dynamic Load Full Load/ Min. Load 90%Duty/3KHz (5)Dynamic Load Full Load/ Min. Load 90%Duty/5KHz (6)Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (7)0%→120% Load. (8).NO LOAD Ta : 25°C	D611 : <u>VO : 115V</u> VD : (1) 308V (2) 308V (3) 308V (4) 308V (5) 308V (6) 308V (7) 308V (8) 280V D613 : <u>VO : 115V</u> VD : (1) 316V (2) 320V (3) 312V (4) 316V (5) 316V (6) 316V (7) 316V (8) 282V	D616 : <u>VO : 115V</u> VD : (1) 316V (2) 320V (3) 316V (4) 316V (5) 316V (6) 316V (7) 316V (8) 284V D619 : <u>VO : 115V</u> VD : (1) 316V (2) 316V (3) 312V (4) 312V (5) 312V (6) 320V (7) 320V (8) 280V

■ SAFETY& E.M.C. TEST

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P : 3.75KVAC/min I/P-FG : 2KVAC/min O/P-FG : 1.25KVAC/min	I/P-O/P : 4.125KVAC/min I/P-FG : 2.4 KVAC/min O/P-FG : 1.5 KVAC/min Ta : 25°C	I/P-O/P : 18.72mA I/P-FG : 15.09mA O/P-FG : 16.39mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P : 500VDC>100M Ω I/P-FG : 500VDC>100M Ω O/P-FG : 500VDC>100M Ω	I/P-O/P : 500 VDC I/P-FG : 500 VDC O/P-FG : 500 VDC Ta : 25°C	I/P-O/P : 6.33 G Ω I/P-FG : 11.4 G Ω O/P-FG : 10.8 G Ω NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 M Ω	40A / 2min Ta : 25°C	27 m Ω

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS A	I/P : 400VAC/50HZ O/P : FULL LOAD Ta : 25°C	PASS
2	CONDUCTION	EN55032 /EN55011 CLASS B	I/P : 400VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS
3	RADIATION	EN55032 /EN55011 CLASS A	I/P : 400VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS
4	E.S.D	EN61000-4-2 <u>INDUSTRY</u> AIR : 8KV / Contact : 4KV	I/P : 400VAC/50HZ O/P : FULL LOAD Ta : 25°C	PASS
5	E.F.T	EN61000-4-4 INDUSTRY INPUT : 2KV	I/P : 400VAC/50HZ O/P : FULL LOAD Ta : 25°C	PASS
6	SURGE	IEC61000-4-5 INDUSTRY L-N : 2KV L,N-PE : 4KV	I/P : 400VAC/50HZ O/P : FULL LOAD Ta : 25°C	PASS
7	Test by certified Lab & Test Report Prepare Any contradictions of the test results, please refer to the latest EMC test report			

■ RELIABILITY TEST

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																																																																
1	TEMPERATURE RISE TEST	MODEL : SHP-10K-115 (Forced air cooling) 1. ROOM AMBIENT BURN-IN : 1.5 HRS I/P : 400VAC O/P : FULL LOAD Ta= 25 °C 2. HIGH AMBIENT BURN-IN : 2HRS I/P : 400VAC O/P : FULL LOAD Ta= 50 °C																																																																																																																																		
		<table><tr><th>NO</th><th>Position</th><th>ROOM AMBIENT Ta= 25°C</th><th>HIGH AMBIENT Ta= 50°C</th></tr><tr><td>1</td><td>C110</td><td>33.0°C</td><td>55.4°C</td></tr><tr><td>2</td><td>D162</td><td>79.7°C</td><td>97.0°C</td></tr><tr><td>3</td><td>D163</td><td>75.6°C</td><td>91.4°C</td></tr><tr><td>4</td><td>L5</td><td>39.0°C</td><td>64.7°C</td></tr><tr><td>5</td><td>Q160</td><td>74.5°C</td><td>88.6°C</td></tr><tr><td>6</td><td>Q161</td><td>71.8°C</td><td>82.2°C</td></tr><tr><td>7</td><td>Q162</td><td>90.7°C</td><td>104.5°C</td></tr><tr><td>8</td><td>Q163</td><td>81.7°C</td><td>102.1°C</td></tr><tr><td>9</td><td>Q164</td><td>85.7°C</td><td>103.7°C</td></tr><tr><td>10</td><td>Q165</td><td>83.7°C</td><td>95.3°C</td></tr><tr><td>11</td><td>RG2</td><td>32.2°C</td><td>59.8°C</td></tr><tr><td>12</td><td>U301</td><td>37.4°C</td><td>61.8°C</td></tr><tr><td>13</td><td>T221</td><td>32.0°C</td><td>58.1°C</td></tr><tr><td>14</td><td>C173</td><td>29.7°C</td><td>53.0°C</td></tr><tr><td>15</td><td>C10</td><td>26.1°C</td><td>54.8°C</td></tr><tr><td>16</td><td>LF2</td><td>45.6°C</td><td>68.7°C</td></tr><tr><td>17</td><td>C8</td><td>38.2°C</td><td>56.4°C</td></tr><tr><td>18</td><td>RY1</td><td>31.6°C</td><td>58.5°C</td></tr><tr><td>19</td><td>C488</td><td>56.6°C</td><td>81.5°C</td></tr><tr><td>20</td><td>C435</td><td>50.6°C</td><td>84.3°C</td></tr><tr><td>21</td><td>C438</td><td>52.6°C</td><td>82.7°C</td></tr><tr><td>22</td><td>C600</td><td>34.8°C</td><td>62.9°C</td></tr><tr><td>23</td><td>Q403</td><td>62.2°C</td><td>85.4°C</td></tr><tr><td>24</td><td>Q404</td><td>64.1°C</td><td>85.7°C</td></tr><tr><td>25</td><td>Q400</td><td>65.2°C</td><td>86.1°C</td></tr><tr><td>26</td><td>T402</td><td>43.3°C</td><td>74.7°C</td></tr><tr><td>27</td><td>T1 core</td><td>52.0°C</td><td>81.8°C</td></tr><tr><td>28</td><td>T1 wire</td><td>78.7°C</td><td>101.3°C</td></tr><tr><td>29</td><td>T2 core</td><td>63.1°C</td><td>77.2°C</td></tr><tr><td>30</td><td>T2 wire</td><td>73.4°C</td><td>98.4°C</td></tr><tr><td>31</td><td>L40 core</td><td>57.5°C</td><td>84.8°C</td></tr></table>			NO	Position	ROOM AMBIENT Ta= 25°C	HIGH AMBIENT Ta= 50°C	1	C110	33.0°C	55.4°C	2	D162	79.7°C	97.0°C	3	D163	75.6°C	91.4°C	4	L5	39.0°C	64.7°C	5	Q160	74.5°C	88.6°C	6	Q161	71.8°C	82.2°C	7	Q162	90.7°C	104.5°C	8	Q163	81.7°C	102.1°C	9	Q164	85.7°C	103.7°C	10	Q165	83.7°C	95.3°C	11	RG2	32.2°C	59.8°C	12	U301	37.4°C	61.8°C	13	T221	32.0°C	58.1°C	14	C173	29.7°C	53.0°C	15	C10	26.1°C	54.8°C	16	LF2	45.6°C	68.7°C	17	C8	38.2°C	56.4°C	18	RY1	31.6°C	58.5°C	19	C488	56.6°C	81.5°C	20	C435	50.6°C	84.3°C	21	C438	52.6°C	82.7°C	22	C600	34.8°C	62.9°C	23	Q403	62.2°C	85.4°C	24	Q404	64.1°C	85.7°C	25	Q400	65.2°C	86.1°C	26	T402	43.3°C	74.7°C	27	T1 core	52.0°C	81.8°C	28	T1 wire	78.7°C	101.3°C	29	T2 core	63.1°C	77.2°C	30	T2 wire	73.4°C	98.4°C	31	L40 core	57.5°C	84.8°C
NO	Position	ROOM AMBIENT Ta= 25°C	HIGH AMBIENT Ta= 50°C																																																																																																																																	
1	C110	33.0°C	55.4°C																																																																																																																																	
2	D162	79.7°C	97.0°C																																																																																																																																	
3	D163	75.6°C	91.4°C																																																																																																																																	
4	L5	39.0°C	64.7°C																																																																																																																																	
5	Q160	74.5°C	88.6°C																																																																																																																																	
6	Q161	71.8°C	82.2°C																																																																																																																																	
7	Q162	90.7°C	104.5°C																																																																																																																																	
8	Q163	81.7°C	102.1°C																																																																																																																																	
9	Q164	85.7°C	103.7°C																																																																																																																																	
10	Q165	83.7°C	95.3°C																																																																																																																																	
11	RG2	32.2°C	59.8°C																																																																																																																																	
12	U301	37.4°C	61.8°C																																																																																																																																	
13	T221	32.0°C	58.1°C																																																																																																																																	
14	C173	29.7°C	53.0°C																																																																																																																																	
15	C10	26.1°C	54.8°C																																																																																																																																	
16	LF2	45.6°C	68.7°C																																																																																																																																	
17	C8	38.2°C	56.4°C																																																																																																																																	
18	RY1	31.6°C	58.5°C																																																																																																																																	
19	C488	56.6°C	81.5°C																																																																																																																																	
20	C435	50.6°C	84.3°C																																																																																																																																	
21	C438	52.6°C	82.7°C																																																																																																																																	
22	C600	34.8°C	62.9°C																																																																																																																																	
23	Q403	62.2°C	85.4°C																																																																																																																																	
24	Q404	64.1°C	85.7°C																																																																																																																																	
25	Q400	65.2°C	86.1°C																																																																																																																																	
26	T402	43.3°C	74.7°C																																																																																																																																	
27	T1 core	52.0°C	81.8°C																																																																																																																																	
28	T1 wire	78.7°C	101.3°C																																																																																																																																	
29	T2 core	63.1°C	77.2°C																																																																																																																																	
30	T2 wire	73.4°C	98.4°C																																																																																																																																	
31	L40 core	57.5°C	84.8°C																																																																																																																																	

32	L40 wire	49.5℃	90.8℃
33	D610	81.0℃	101.6℃
34	D614	79.7℃	99.3℃
35	D618	52.5℃	98.1℃
36	D619	83.1℃	77.9℃
37	RT61	38.7℃	64.4℃
38	RT64	47.6℃	77.7℃
39	RT65	53.5℃	72.9℃
40	RTH6	42.2℃	60.6℃
41	RTH7	35.0℃	61.3℃
42	C643	28.1℃	55.2℃
43	C635	26.4℃	55.1℃
44	C518	27.2℃	50.1℃
45	U504	27.8℃	50.6℃
46	T900	33.0℃	54.3℃
47	T901	30.9℃	51.3℃
48	Q930	36.4℃	56.7℃
49	D951	43.2℃	65.0℃
50	CK12	29.8℃	50.1℃
51	C951	31.6℃	52.3℃
52	C439	40.1℃	62.3℃
53	C440	44.3℃	66.7℃

MODEL : SHP-10K-115 (Water cooling)

Inlet temperature : 15℃ · Flow rate (minimum) : 4 LPM

1. ROOM AMBIENT BURN-IN : 2.5 HRS

I/P : 400VAC O/P : FULL LOAD Ta= 25 °C

2. HIGH AMBIENT BURN-IN : 2.5HRS

I/P : 400VAC O/P : FULL LOAD Ta= 50 °C

NO	Position	ROOM AMBIENT Ta= 25℃	HIGH AMBIENT Ta= 50℃
1	C110	42.10℃	44.20℃
2	D162	44.55℃	44.10℃
3	D163	43.90℃	43.95℃
4	L5	56.95℃	59.30℃
5	Q160	52.50℃	52.75℃
6	Q161	61.40℃	61.85℃
7	Q162	43.75℃	46.85℃
8	Q163	58.40℃	58.35℃
9	Q164	48.30℃	48.00℃
10	Q165	51.85℃	52.30℃
11	RG2	35.55℃	43.30℃
12	U301	54.95℃	55.90℃

			13	T221	35.95°C	45.30°C
			14	C173	43.70°C	50.40°C
			15	C10	49.00°C	51.10°C
			16	LF1	53.90°C	51.85°C
			17	LF2	56.60°C	54.95°C
			18	C8	46.25°C	53.55°C
			19	RY1	36.35°C	42.05°C
			20	C488	46.95°C	49.40°C
			21	C435	63.80°C	83.00°C
			22	C438	61.95°C	87.25°C
			23	C600	47.40°C	53.70°C
			24	Q404	42.70°C	43.50°C
			25	Q400	42.10°C	44.30°C
			26	T402	53.80°C	61.25°C
			27	T1 core	67.60°C	66.95°C
			28	T1 wire-1	69.05°C	68.65°C
			29	T2 core	73.70°C	76.05°C
			30	T2 wire	78.30°C	80.50°C
			31	L40 wire	80.15°C	82.45°C
			32	D611	90.65°C	93.90°C
			33	D613	66.65°C	70.25°C
			34	D618	60.90°C	64.10°C
			35	D619	91.70°C	95.40°C
			36	RT61	44.05°C	42.85°C
			37	RT63	68.55°C	76.50°C
			38	RT64	41.65°C	44.80°C
			39	RT65	42.20°C	44.10°C
			40	RTH6	70.10°C	81.95°C
			41	RTH7	75.70°C	84.00°C
			42	C641	73.90°C	95.15°C
			43	C634	74.55°C	88.90°C
			44	C518	48.25°C	57.05°C
			45	U504	47.30°C	56.45°C
			46	T900	65.05°C	74.60°C
			47	T901	56.60°C	62.45°C
			48	Q930	80.10°C	79.85°C
			49	D951	63.45°C	71.00°C
			50	CK12	54.75°C	60.10°C
			51	T1 wire-2	57.05°C	63.55°C
			52	C439	64.45°C	66.85°C
			53	C440	62.55°C	65.75°C
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR (MIN)	I/P : 400 VAC O/P : 101%LOAD Ta : 25°C		TEST : OK	
3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 530VAC/340VAC O/P : 100 %LOAD Ta= -35°C		TEST : OK	

4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 50 °C/95 %R.H NO DAMAGE	I/P : 540 VAC O/P : FULL LOAD Ta= 50°C HUMIDITY= 95 %R.H	TEST : OK
5	TEMPERATURE COEFFICIENT	± 0.03 %/°C(0~50°C)	I/P : 400 VAC O/P : FULL LOAD	± 0.004 %/°C(0~50°C)
6	STORAGE TEMPERATURE TEST	-40~85°C	1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : STATIC	
7	THERMAL SHOCK TEST	-30~50°C	1. Thermal shock Temperature : -35°C~ +55°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 16 CYCLE 5. Input/Output condition : 15cycle:380V/ FULL LOAD AC ON 3sec/AC OFF 1sec TEST 1cycle:380V/ FULL LOAD Burn In Test	
8	VIBRATION TEST	10 ~ 500Hz, 2G 10min./1cycle, 60min. each along X, Y, Z axes	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 3G (5) Test Time : 180min in each axis (X.Y.Z) (6) Ta : 25°C	
9	CAPACITOR LIFE CYCLE	SUPPOSE C643 IS THE MOST CRITICAL COMPONENT 1. Forced air cooling (1) I/P : 400VAC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 400VAC O/P : FULL LOAD Ta= 50 °C LIFE TIME (3) I/P : 400VAC O/P : 75% LOAD Ta= 50 °C LIFE TIME (4) I/P : 400VAC O/P : 50% LOAD Ta= 50 °C LIFE TIME		(1) 1255888HRS (2) 190611HRS (3) 343879HRS (4) 509875HRS
		2. Water cooling (1) I/P : 400VAC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 400VAC O/P : FULL LOAD Ta= 50 °C LIFE TIME (3) I/P : 400VAC O/P : 75% LOAD Ta= 50 °C LIFE TIME (4) I/P : 400VAC O/P : 50% LOAD Ta= 50 °C LIFE TIME		(1) 1216239HRS (2) 11154HRS (3) 104023HRS (4) 312779HRS
10	MTBF	Conducted by Parts Stress Analysis Prediction 281.2K hrs min. Telcordia SR-332 (Bellcore) ; 28K hrs min. MIL-HDBK-217F (25°C)		
11	Ongoing Reliability Test	I/P : 380VAC O/P : FULL LOAD TA=50°C Demonstration Mean Time Between Failure : 50,000 hours		

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	DANIEL GAO	SANFORD SU	VINCENT TSENG

2020.10.1 TAG-QA-009



10KW 3 ψ 3W High Efficiency Digital Power Supply

SHP-10K series
