



























- Universal AC input / Full range
- Built-in active PFC function, PF>0.95
- · High efficiency up to 94%
- · Withstand 300VAC surge input for 5 seconds
- · Up to 320% peak power capability
- Protections: Short circuit / Overload / Over voltage / Over temperature
- Built-in cooling fan ON-OFF control
- Current sharing up to 4000W (3+1)
- Built-in DC OK / remote ON-OFF / remote sense functions
- Standby power 5V@0.3A
- No load power consumption<0.85W (Note.7)
- 5 years warranty

Applications

- · Factory control or automation apparatus
- Test and measurement instrument
- · Laser related machine
- Aging equipment
- · RF application
- · For inductive and capacitive load


■ GTIN CODE

MW Search: https://www.meanwell.com/serviceGTIN.aspx

Description

HRPG-1000N3 series is a 1000W single output AC/DC with ultra-hight peak power supply. This series operates for $90^{\sim}264$ VAC input voltage and offers models with different rated voltage ranging between 12 and 48 V that can satisfy the demands for all kinds of industrial equipments. Each model is cooled by the built-in fan with speed control, working for the temperature up to 70°C . Moreover, HRPG-1000N3 has various built-in functions such as auxiliary power, remote sense and remote on-off control, offering vast design flexibility for industrial application. It can provide 320% short-duration peak power for motor applications and electromechanical loads requiring much higher power during start-up.







1000W Ultra-High Peak Power Supply

IODEL		HRPG-1000N3-12	HRPG-1000N3-24	HRPG-1000N3-36	HRPG-1000N3-48		
	DC VOLTAGE	12V	24V	36V	48V		
	RATED CURRENT	80A	42A	28A	21A		
	CURRENT RANGE	0 ~ 80A	0 ~ 42A	0 ~ 28A	0 ~ 21A		
		960W	1008W	1008W	1008W		
	RATED POWER						
ОИТРИТ	RIPPLE & NOISE (max.) Note.2		200mVp-p	250mVp-p	250mVp-p		
	VOLTAGE ADJ. RANGE	11 ~ 14V	22 ~ 28V	32 ~ 38V	46 ~ 56V		
	VOLTAGE TOLERANCE Note.3	±2.0%	±1.0%	±1.0%	±1.0%		
	LINE REGULATION	±0.5%	±0.5%	±0.5%	±0.5%		
	LOAD REGULATION	±2.0%	±0.5%	±0.5%	±0.5%		
	SETUP, RISE TIME	1000ms, 50ms/230VAC 2000ms, 50ms/115VAC at full load					
	HOLD UP TIME (Typ.)	16ms/230VAC 16ms/115VAC at full load					
	VOLTAGE RANGE	90 ~ 264VAC(300VAC for 5 sec	c.) 127 ~ 370VDC				
	FREQUENCY RANGE	47 ~ 63Hz					
	POWER FACTOR (Typ.)	PF>0.95/230VAC PF>0.99/115VAC at full load					
NPUT	EFFICIENCY (Typ.)	91.5% 93% 93% 94%					
	AC CURRENT (Typ.)	8.5A/115VAC 5A/230VAC					
	INRUSH CURRENT (Typ.)	25A/115VAC 40A/230VAC					
	LEAKAGE CURRENT	<1.2mA/240VAC	<u>, </u>				
	LLARAGE CORRENT						
		Output power > 105% rated for more than 5 seconds then shut down o/p voltage, re-power on to recover Output power > 320% rated then shut down o/p voltage, re-power on to recover for 12V					
	OVERLOAD Note.4						
ROTECTION		Output power > 350% rated th					
	OVER VOLTAGE	14.5 ~ 16.5V	29 ~ 33V	39 ~ 46V	58 ~ 65V		
	OVER VOLIAGE	Protection type : Shut down o/p	o voltage, re-power on to rec	over			
	OVER TEMPERATURE	Shut down o/p voltage, recover	rs automatically after temper	ature goes down			
	CURRENT SHARING	Up to 4000W or (3+1) units. Ple	ase refer to the function manu	ıal.			
	REMOTE ON-OFF CONTROL	Power ON : short; Power OFF :	open. Please refer to the func	tion manual.			
	REMOTE SENSE	,			anual		
UNCTION	DC-OK SIGNAL	Compensate voltage drop on the load wiring up to 0.5V. Please refer to the function manual. The TTL signal out PSU turn on = 3.3 ~ 5.6V PSU turn off = 0 ~ 1V. Please refer to the function manual.					
	5V STANDBY	The TTL signal out, PSU turn on = 3.3 ~ 5.6V; PSU turn off = 0 ~ 1V. Please refer to the function manual. 5VSB: 5V@0.3A; tolerance ±5%, ripple: 50mVp-p(max.)					
		Fan on/off by NTC(RT50) or 30					
	FAN CONTROL	-40 ~ +70°C (Refer to "Derating					
	WORKING TEMP.	,	g Curve)				
	WORKING HUMIDITY	20 ~ 90% RH non-condensing					
NVIRONMENT	STORAGE TEMP., HUMIDITY	-40 ~ +85°C, 10 ~ 95% RH non	-condensing				
	TEMP. COEFFICIENT	±0.03%/°C (0 ~ 50°C)					
	VIBRATION	10 ~ 500Hz, 5G 10min./1cycle					
	SAFETY STANDARDS	UL62368-1, CAN/CSA C22.2 N	<u> </u>	62368-1, AS/NZS62368.	.1, EAC TP TC 004 approved		
	WITHSTAND VOLTAGE	I/P-O/P:3KVAC I/P-FG:2KV/	AC O/P-FG:0.5KVAC				
	ISOLATION RESISTANCE	I/P-O/P, I/P-FG, O/P-FG:100M	Ohms / 500VDC / 25°C / 70%	K RH			
		Parameter	Standard		Test Level / Note		
		Conducted	BS EN/EN55032	(CISPR32)	Class B		
	EMC EMISSION	Radiated	BS EN/EN55032	(CISPR32)	Class B		
		Harmonic Current	BS EN/EN61000	-3-2	Class A		
		Voltage Flicker	BS EN/EN61000				
		BS EN/EN55035, BS EN/EN610					
AFETY &		Parameter	Standard		Test Level / Note		
MC		ESD	BS EN/EN61000	1.2			
					Level 3, 8KV air ; Level 2, 4KV contact		
	EMC IMMUNITY	Radiated	BS EN/EN61000		Level 3		
		EFT / Burst	BS EN/EN61000		Level 3		
		Surge	BS EN/EN61000	-4-5	Level 4, 2KV/Line-Line 4KV/Line-Earth		
		Conducted	BS EN/EN61000	-4-6	Level 3		
		Magnetic Field	BS EN/EN61000	-4-8	Level 4		
		Voltage Dips and Interruptions	BS EN/EN61000	-4-11	>95% dip 0.5 periods, 30% dip 25 period >95% interruptions 250 periods		
	MTBF	989.2K hrs min. Telcordia SR-332 (Bellcore); 130.6K hrs min. MIL-HDBK-217F (25°C)					
THERS	DIMENSION	218*105*61.5mm (L*W*H)					
	PACKING	1.46Kg;8pcs/12.8Kg/1.58CUFT					
ОТЕ	Ripple & noise are measured Tolerance : includes set up to After the output protection, re Derating may be needed une Length of set up time is mea No load power consumption. The power supply is conside a 360mm*700mm metal plate.	eters NOT specially mentioned are measured at 230VAC input, rated load and 25°C of ambient temperature. orise are measured at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a 0.1 μ F & 47 μ F parallel capacitor. includes set up tolerance, line regulation and load regulation. output protection, restart the device about 30 seconds after the input disconnection interval. may be needed under low input voltages. Please check the derating curve for more details. set up time is measured at first cold start. Turning ON/OFF the power supply may lead to increase of the set up time. ower consumption<0.85W when RC+ & RC- (CN100 pin3,4) open. or supply is considered a component which will be installed into a final equipment. All the EMC tests are been executed by mounting the unit on room metal plate with 1mm of thickness. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how to be the set with 1mm of thickness component power supplies." ble on https://www.meanwell.com//Upload/PDF/EMI_statement_en.pdf) ent temperature derating of 3.5°C/1000m with fanless models and of 5°C/1000m with fan models for operating altitude higher than 2000m(6500ft).					






PFC:65KHz PWM:90KHz

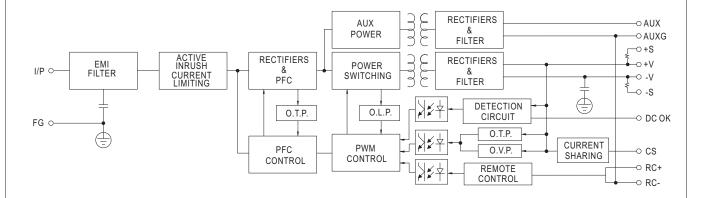


■ Derating Curve

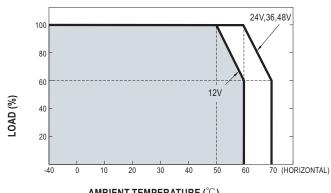

AMBIENT TEMPERATURE (°C)

■ Output Derating VS Input Voltage

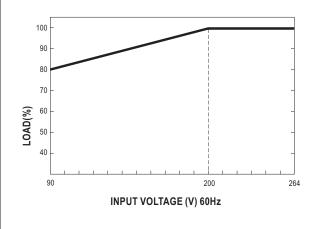




■ Function Manual

1.Peak Power

$$P_{av} = \frac{P_{pk} x t + P_{npk} x (T-t)}{T} \leqslant P_{rated}$$

Duty =
$$\frac{t}{T}$$
 x 100% $\leq 35\%$



Pav: Average output power (W)

P_{pk}: Peak output power (W)


Pnpk: Non-peak output power(W)

 P_{rated} : Rated output power(W)

t : Peak power width (sec)

T: Period(sec)



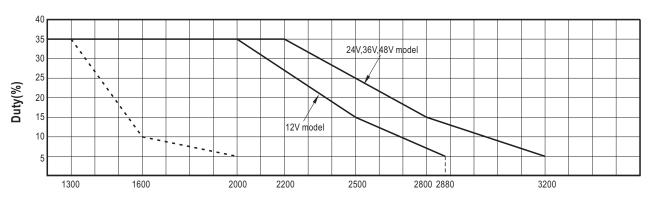

Peak output power (W)

For example (24V model):

$$P_{av} = P_{rated} = 1008W$$

$$P_{pk} = 2500W$$

$$T \ge \frac{5 \text{ sec}}{25\%} \ge 20 \text{sec}$$

$$P_{npk} \leqslant \frac{T P_{av} - t P_{pk}}{T - t}$$

$$P_{npk} \le 511W$$



■ Function Description of CN100

Pin No.	Function	Description
1	AUXG	Auxiliary voltage output ground.
2	AUX	Auxiliary voltage output, 4.75~5.25V, referenced to pin 1(AUXG). The maximum load current is 0.3A. This output is not controlled by the "remote ON/OFF control".
3	RC+	Turns the output on and off by electrical or dry contact between pin 4 (RC-), Short: Power ON, Open: Power OFF.
4	RC-	Remote control ground.
5	1 66	Current sharing signal. When units are connected in parallel, the CS pins of the units should be connected to allow current balance between units.
6,8	GND	This pin connects to the negative terminal(-V). Return for DC-OK signal output.
7	DC-OK	DC-OK signal is a TTL level signal, referenced to pin8(DC-OK GND). High when PSU turns on.
9		Positive sensing. The +S signal should be connected to the positive terminal of the load. The +S and -S leads should be twisted in pair to minimize noise pick-up effect. The maximum line drop compensation is 0.5V.
10		Negative sensing. The -S signal should be connected to the negative terminal of the load. The -S and +S leads should be twisted in pair to minimize noise pick-up effect. The maximum line drop compensation is 0.5V.

■ Function Manual

1.Remote Sense

The remote sensing compensates voltage drop on the load wiring up to 0.5 V.

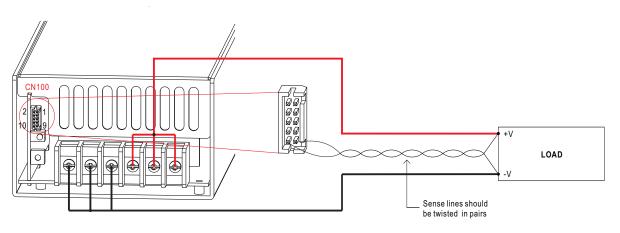


Fig 1.1

2.DC-OK Signal

 $\label{eq:DC-OK} {\sf DC-OK\, signal\, is\, a\, TTL\, level\, signal.\, High\, when\, PSU\, turns\, on.}$

Between DC-OK(pin7) and GND(pin6,8)	Output Status
3.3 ~ 5.6V	ON
0 ~ 1V	OFF

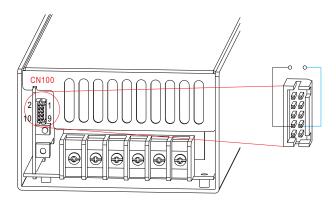


Fig 2.1



3.Remote ON-OFF Control

The PSU can be turned ON/OFF by using the "Remote Control" function.

Between RC+(pin3) and RC-(pin4)	Output Status
SW ON (Short)	ON
SW OFF (Open)	OFF

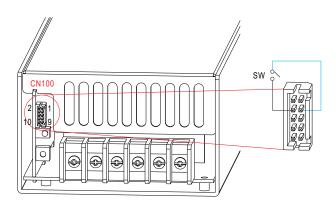


Fig 3.1


4. Current Sharing

HRPG-1000N3 has the built-in active current sharing function and can be connected in parallel, up to 4 units, to provide higher output power as exhibited below:

- ※The power supplies should be paralleled using short and large diameter wiring and then connected to the load.
- X Difference of output voltages among parallel units should be less than 0.2V.
- ** The total output current must not exceed the value determined by the following equation: Maximum output current at parallel operation=(Rated current per unit) \times (Number of unit) \times 0.9
- ※ When the total output current is less than 5% of the total rated current, or say (5% of Rated current per unit)

 × (Number of unit)

 the current shared among units may not be fully balanced.

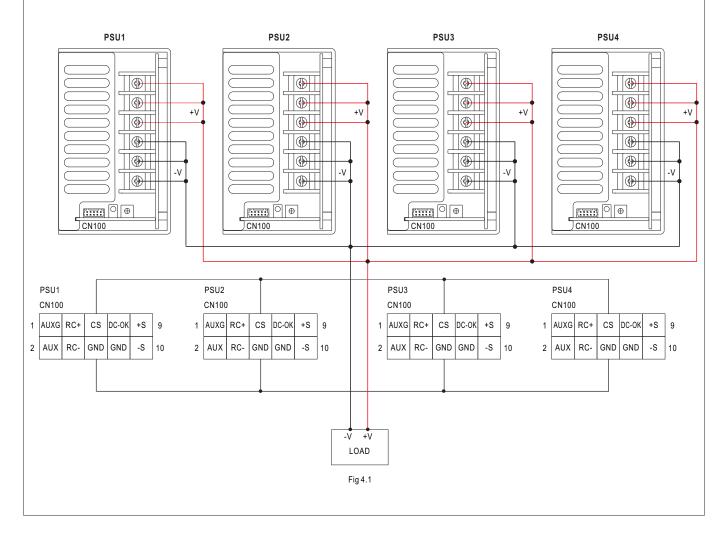






■ Mechanical Specification

(Unit: mm , tolerance ± 1mm)

Case No. 977H

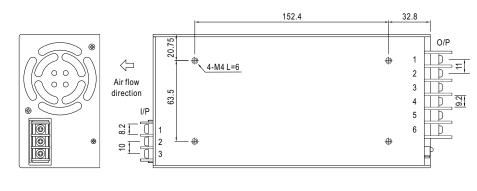



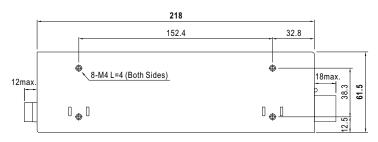

AC Input Terminal Pin No. Assignment

Pin No.	Assignment	
1	AC/L	
2	AC/N	
3	FG ±	

DC Output Terminal Pin No. Assignment

Pin No.	Assignment		
1~3	+V		
4~6	-V		

Connector Pin No. Assignment(CN100): HRS DF11-10DP-2DS or equivalent

Pin No.	Assignment	Pin No.	Assignment	Mating Housing	Terminal
1	AUXG	6,8	GND		
2	AUX	7	DC-OK	UD0 DE44 40D0	UD0 DE44 **00
3	RC+	9	+S	HRS DF11-10DS or equivalent	or equivalent
4	RC-	10	-S	or oquivaloni	or oquivalone
5	CS				

■ Installation Manual

Please refer to: http://www.meanwell.com/manual.html